

Ductwork in aerated concrete - principle configuration

0039

1

Fire Resistance Test In Accordance With EN 1366-3 / aerated concrete floor 150mm

Ductwork 1000 x 1000 mm


with 1500 mm LI Firetect PA board 1S 50 mm
in Firetect PA board 2S 60 mm

EI 60 minutes

aperture 1200 x 1200 mm

and smoke seal Firetect Acrylic

C/U

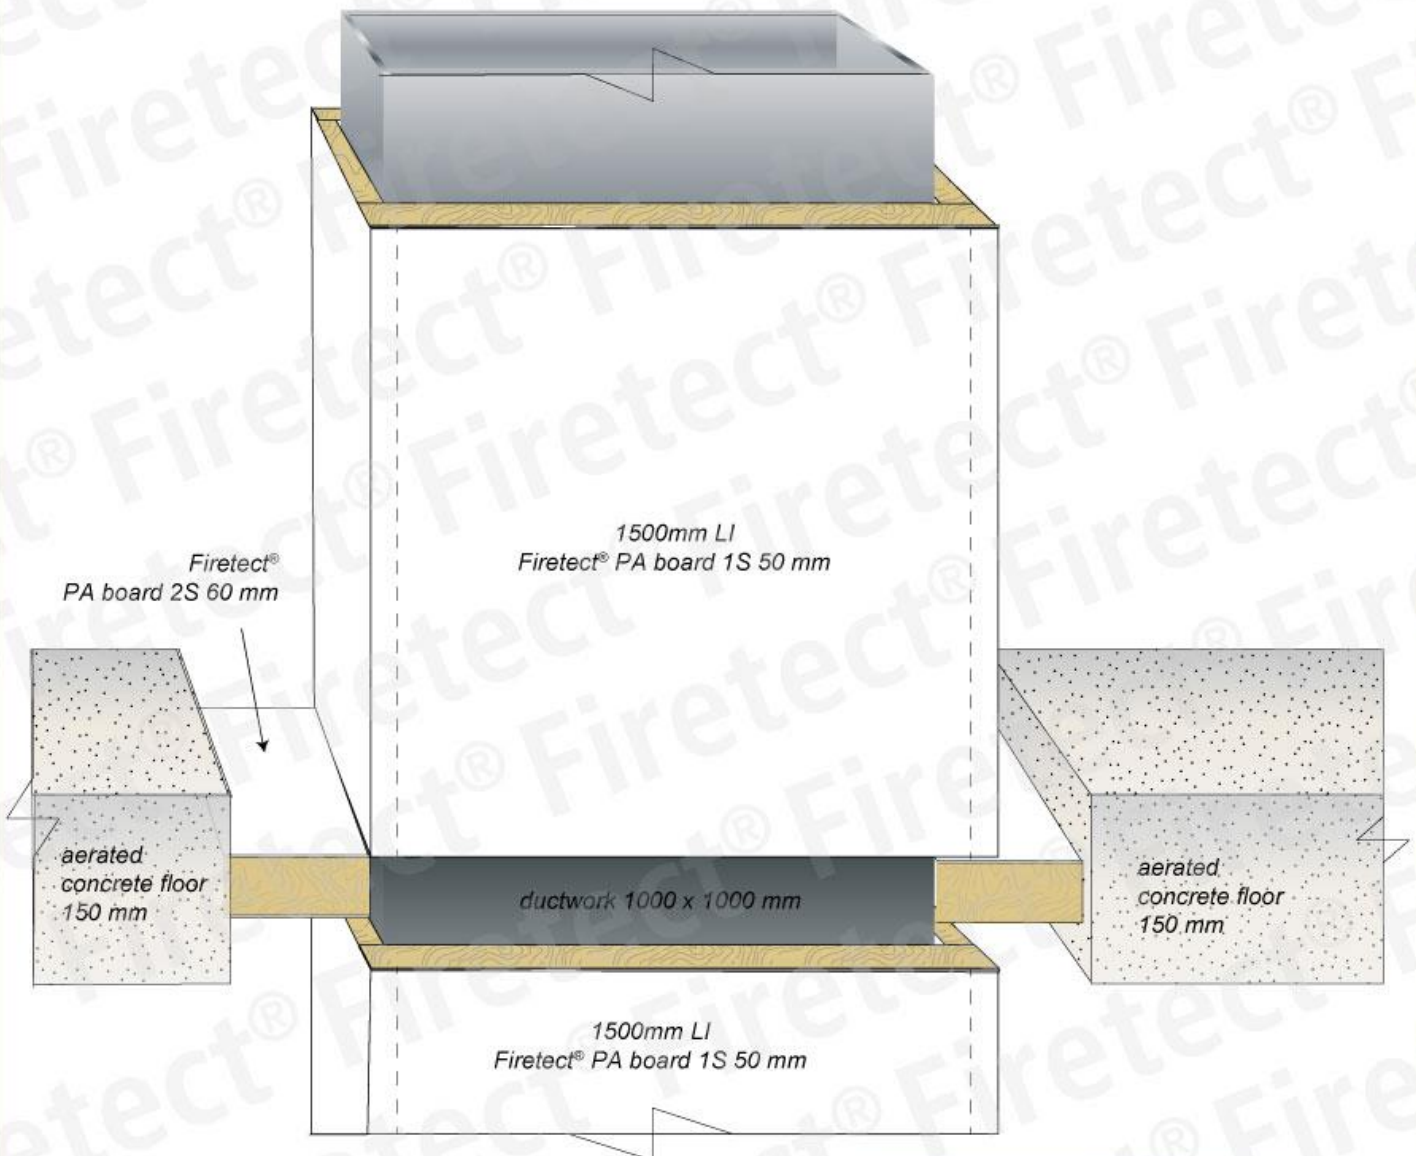

Exposed side

