


tested property
test method
service no.

fire resistance
EN 1366-3
10-29

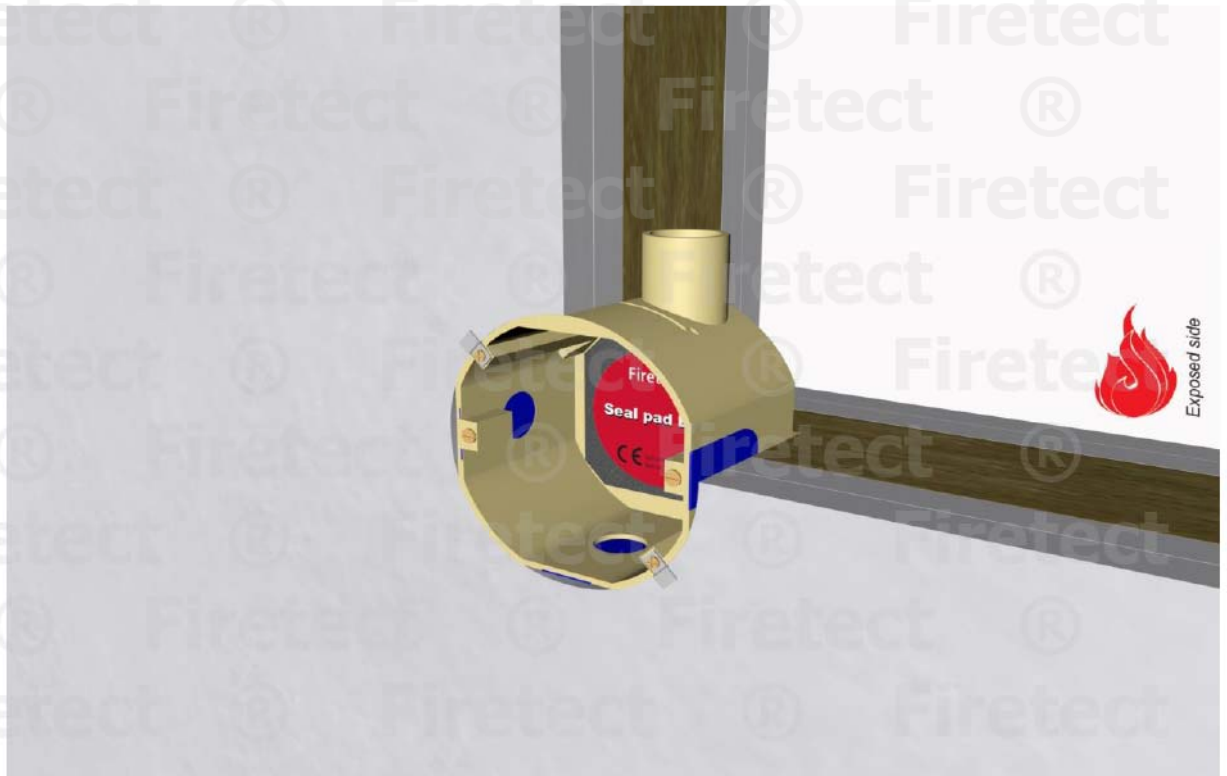

electrical socket boxes

Seal pad EVO

| type | max. size (mm) ¹⁾ | | | acc. EN 1366-3 | acc. EN 1364-1 | EI | constructive element ²⁾ | Firetect putty pad 1 per module | application | | finish required | |
|------------------------------------|------------------------------|--------|-------|-------------------------------------|-------------------------------------|--------|------------------------------------|------------------------------------|---------------|--------------|--------------------|---|
| | width | height | depth | | | | | | 1 side | 2 sides | | |
| single socket | 76 | 76 | 71 | <input checked="" type="checkbox"/> | | EI 60 | flexible walls ≥ 100 mm | 1 EVO | exposed | | - | |
| | 84 | 90 | 73 | | <input checked="" type="checkbox"/> | EI 90 | flexible walls ≥ 100 mm | 1 EVO | exposed | | - | |
| | 76 | 76 | 50 | <input checked="" type="checkbox"/> | | EI 120 | flexible walls ≥ 100 mm | 1 EVO | unexposed | | - | |
| | 84 | 90 | 73 | | <input checked="" type="checkbox"/> | EI 60 | flexible walls ≥ 100 mm | 1 EVO | unexposed | | - | |
| | 76 | 76 | 50 | <input checked="" type="checkbox"/> | | EI 120 | flexible walls ≥ 100 mm | 2x 1 EVO | | back-to-back | - | |
| | 76 | 76 | 50 | | <input checked="" type="checkbox"/> | EI 60 | flexible walls ≥ 100 mm | 2x 1 EVO | | back-to-back | - | |
| | 77 | 77 | 56 | <input checked="" type="checkbox"/> | | EI 120 | rigid walls ≥ 100 mm | 1 EVO | exposed | | - | |
| | 77 | 77 | 56 | <input checked="" type="checkbox"/> | | EI 120 | rigid walls ≥ 100 mm | 1 EVO | unexposed | | - | |
| | 77 | 77 | 56 | <input checked="" type="checkbox"/> | | EI 120 | rigid walls ≥ 100 mm | 2x 1 EVO | | back-to-back | - | |
| | 70 | 70 | 55 | <input checked="" type="checkbox"/> | | EI 120 | flexible ceilings ≥ 150 mm | 1 EVO | exposed | | - | |
| single on row (max. 5x on row) | 380 | 76 | 71 | <input checked="" type="checkbox"/> | | EI 60 | flexible walls ≥ 100 mm | max. 5x 1 EVO | exposed | | - | |
| double socket (2x module) | 152 | 76 | 50 | <input checked="" type="checkbox"/> | | EI 90 | flexible walls ≥ 100 mm | 4x 1 EVO | | back-to-back | - | |
| | | | | <input checked="" type="checkbox"/> | | EI 90 | rigid walls ≥ 100 mm | 4x 1 EVO | | back-to-back | - | |
| modular socket (max. 4x module) | 284 | 73 | 53 | <input checked="" type="checkbox"/> | | EI 60 | flexible walls ≥ 100 mm | max. 8x 1 EVO | | back-to-back | - | |
| | | | | | <input checked="" type="checkbox"/> | | EI 60 | flexible walls ≥ 100 mm | max. 8x 1 EVO | | back-to-back | - |
| | | | | | <input checked="" type="checkbox"/> | | EI 60 | rigid walls ≥ 100 mm | max. 8x 1 EVO | | back-to-back | - |
| | | | | | <input checked="" type="checkbox"/> | | EI 60 | rigid walls ≥ 100 mm | max. 8x 1 EVO | | back-to-back | - |

¹⁾ Size is actual size, not mounting size!

²⁾ Constructive element must be classified acc. EN 13501-2 for the required fire resistance period.