

plastic pipe in PA Board

0075

Fire Resistance Test In Accordance With EN 1366-3 / flex wall 100mm


PE/PP/PVC pipe Ø 110mm

with Firetect FMU collar Ø 110mm on both sides

in 2x PA board 50mm 2s

collar fixed with PA spirals

U/C

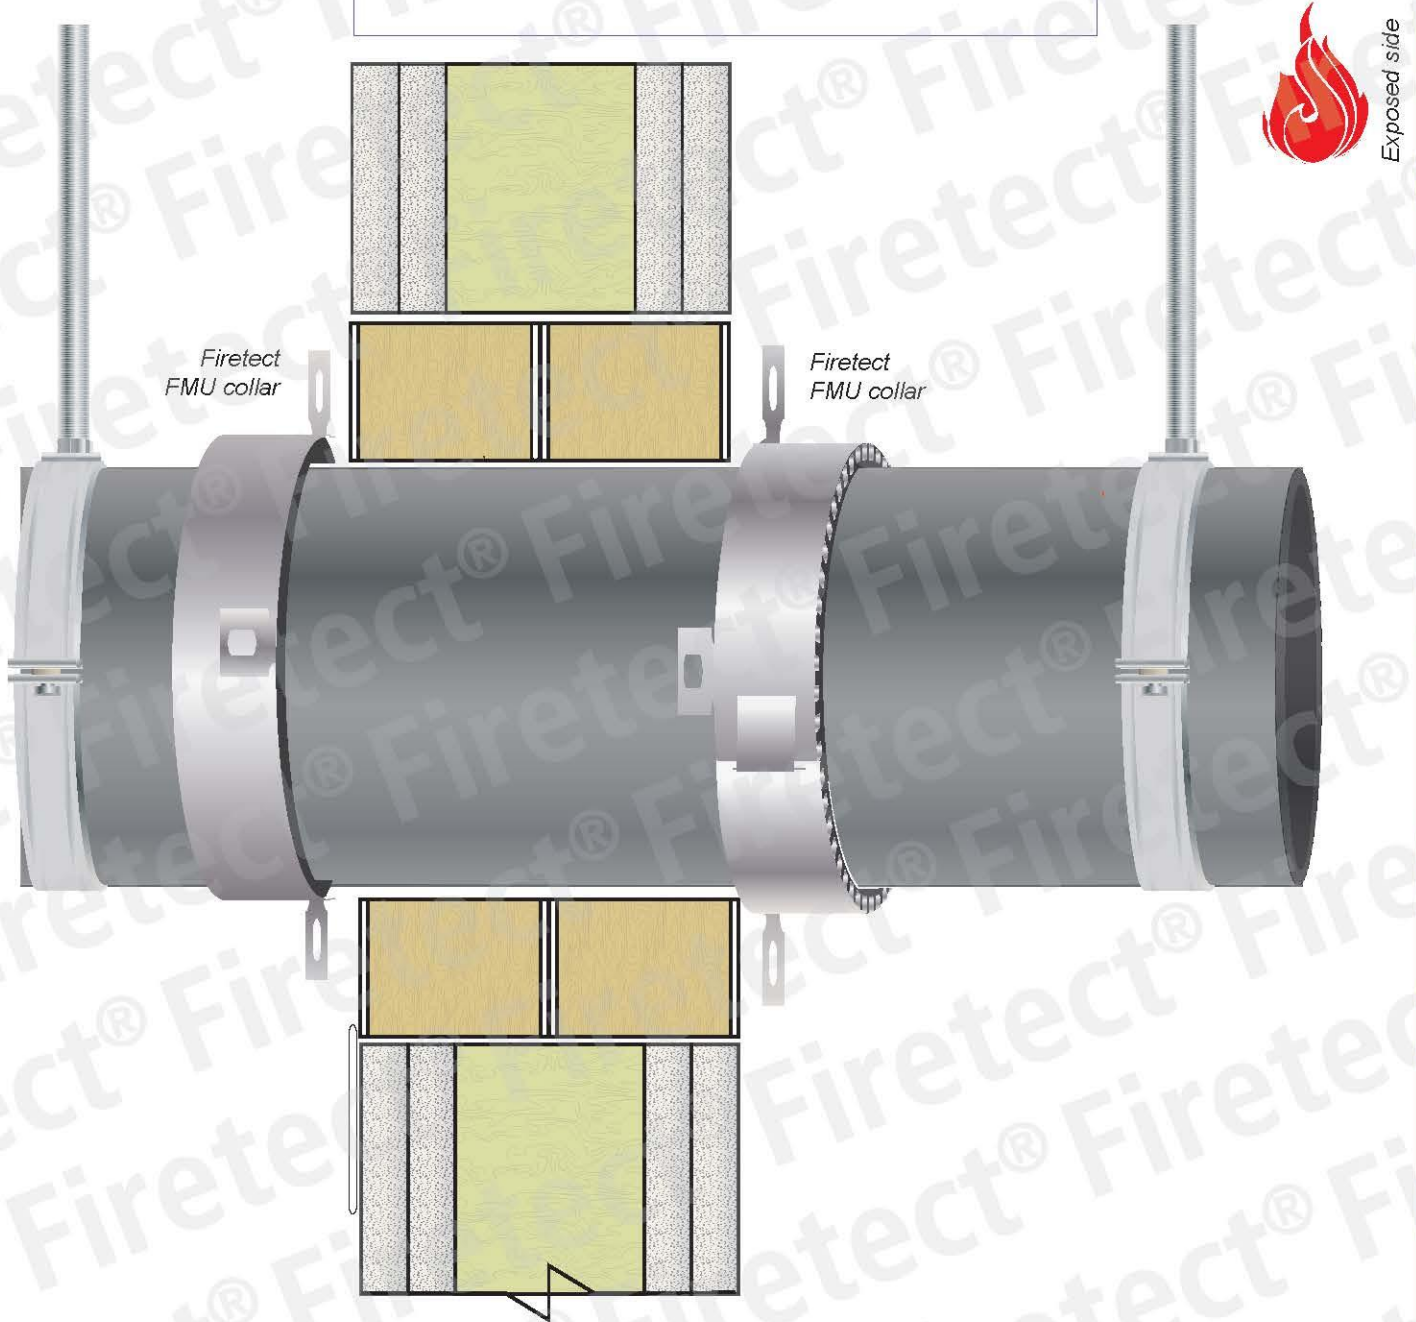

PE/PP/PVC pipe

Firetect FMU collar

