


steel pipe in Firetect® PA Board		0264	2.7
Fire Resistance Test In Accordance With EN 1366-3 / flex wall 100mm			
Steel pipe Ø 219,1 x 4,5 mm insulated by 25 mm Armaflex AF / LS 1000	with Firetect Graphite sealant 10 x 25 mm (wxd) from both side	EI 60 minutes	
aperture Ø 290 mm		C/U	



Firetect Graphite sealant 10 x 25 mm

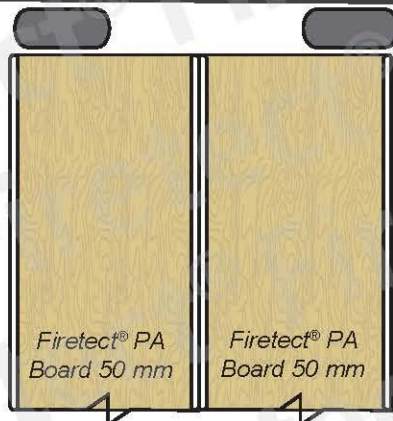

Firetect® PA Board 50 mm

Firetect Graphite sealant 10 x 25 mm

25mm Armaflex AF / LS 1000

steel pipe Ø 219,1 x 4,5 mm

