


<b>Linear joint, vertically in metal stud</b>		14.4
<b>Fire Resistance Test In Accordance With EN 1366-4 / flex wall 100mm</b>		
Linear joint, vertically	with Firetect Flex strip 30 x 25 mm (wxd) on both sides	<b>EI 90 minutes</b>
joint 25 mm		

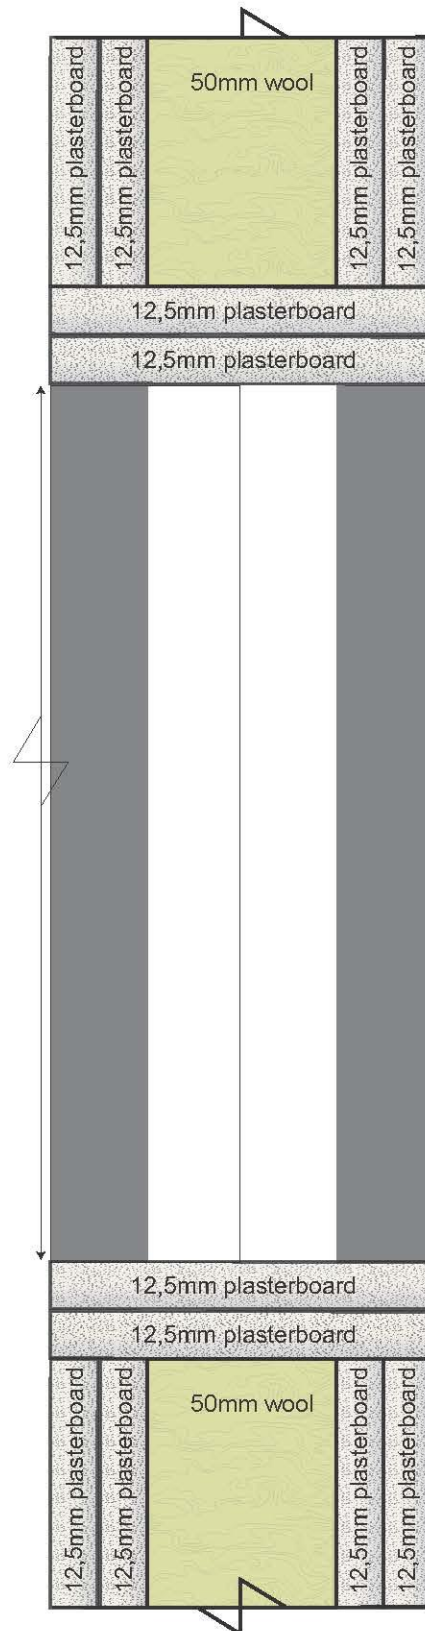

*Firetect Flex strip  
30 x 25 mm (wxd)  
on both sides*