


plastic pipes in metal stud

P0245

Fire Resistance Test In Accordance With EN 1366-3 / flex wall

with Firetect FMU collar on box of Firetect PA board

and smoke seal Firetect Acrylic

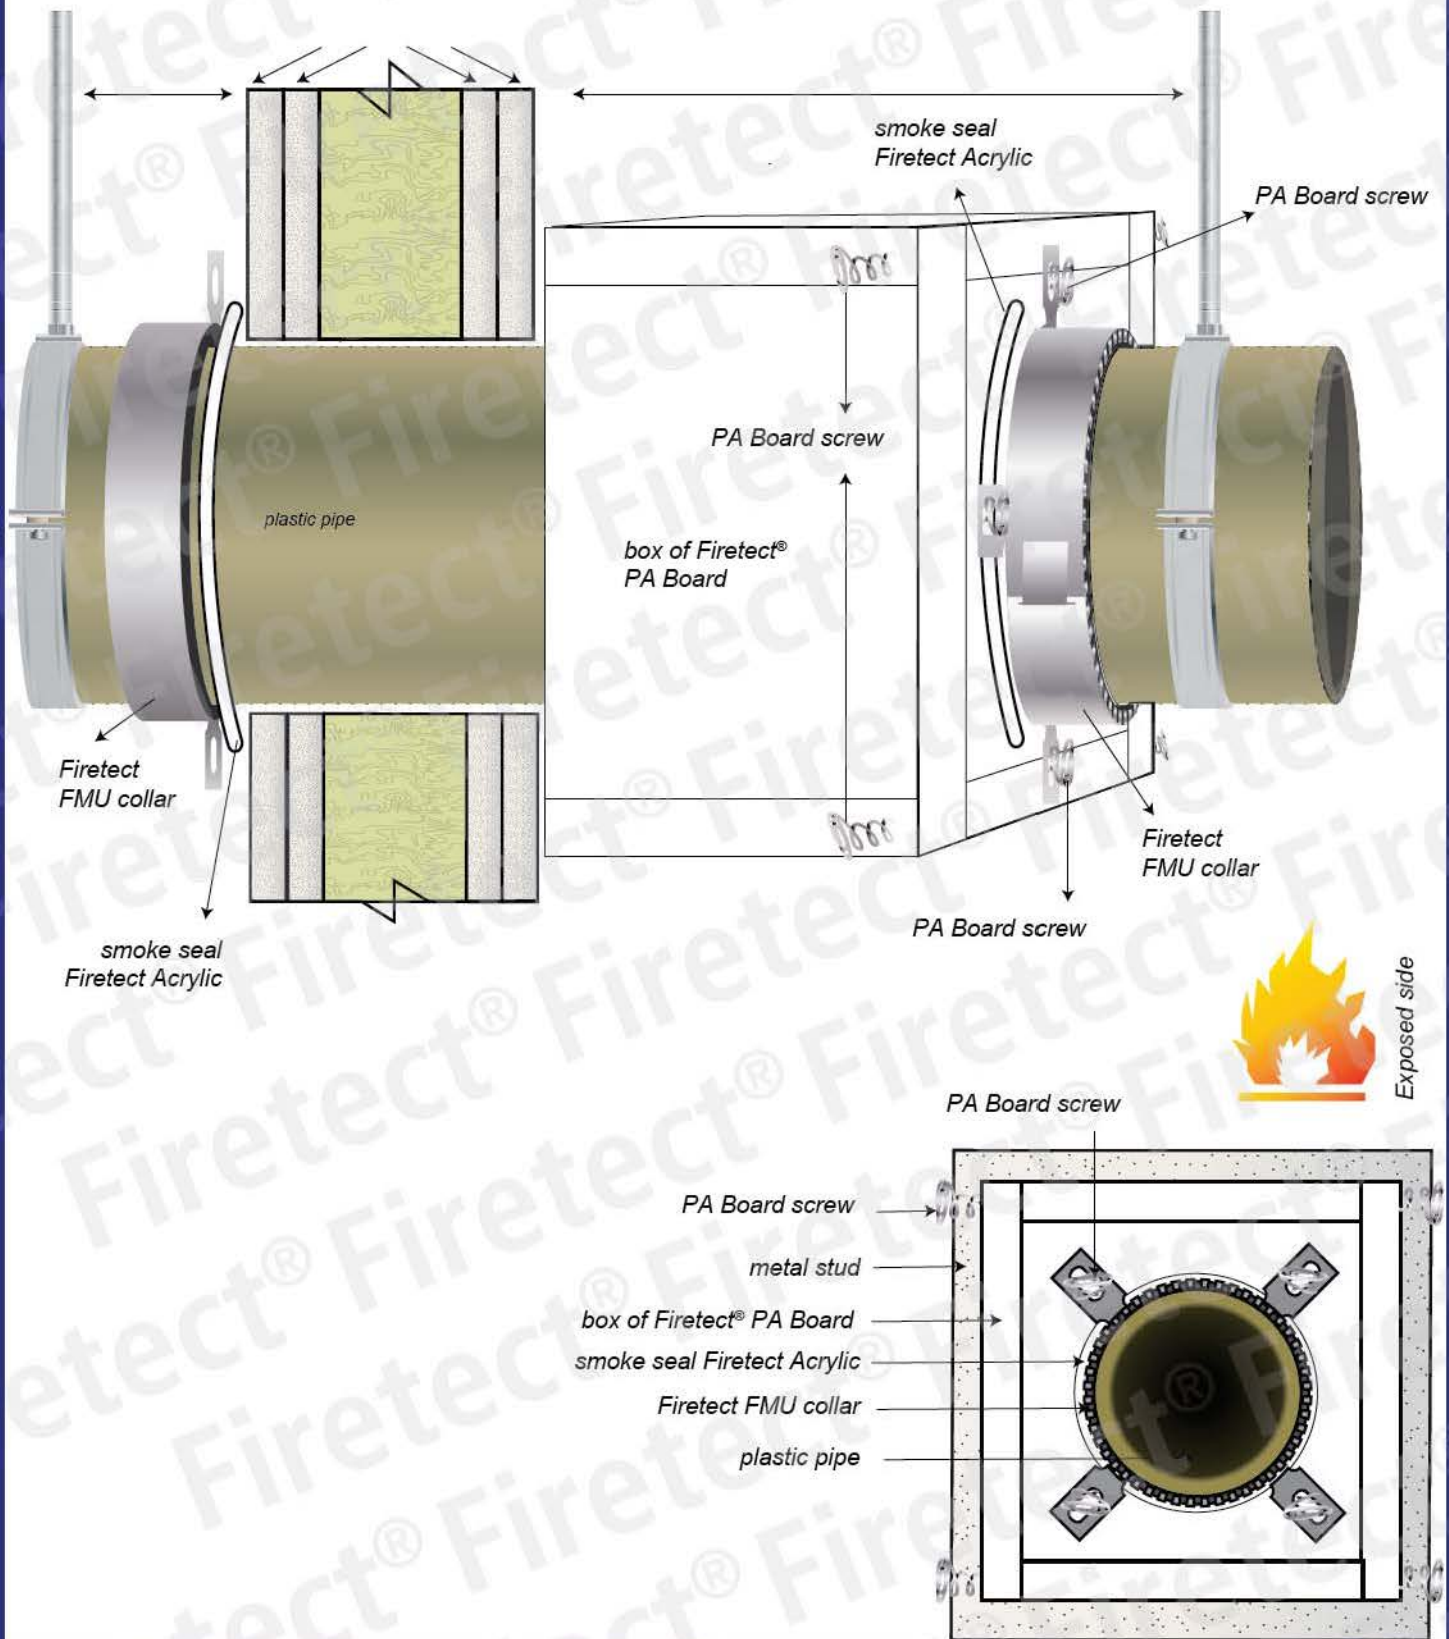

plastic pipes in PA board

P0075

Fire Resistance Test In Accordance With EN 1366-3 / flex wall

with Firetect FMU collar

collar fixed with PA screws

